HEADER SCHEDULE

MARK	SIZE & TYPE	REMARK
H-1	(3)-1¾ x 9¼ LVL +¼ PW	REFER TO DET. 3&4/S-5.1
H-2	3-2x10's + (2) ½ PW	REFER TO DET. 3&4/S-5.1
H-3	3-2x6's + (2) ½ PW	REFER TO DET. 3&4/S-5.1
H-4	3-1¾ x11⅞ LVL +½ PW	REFER TO DET. 3/S-5.1. ATTACH TO POSTS w/ SIMPSON HUCQ 612-SDS EA END

NOTE: ALL HEADERS ARE LAMINATED TOGETHER w/ PLYWOOD TO FORM A 5 1/2" WIDE SECTION. REF. DETAIL 3/S5.1 ALL HEADERS SHALL HAVE A MINIMUM BEARING @ EACH END AS INDICATED IN HEADER BEARING DETAIL 4/S-5.1.

BRICK LINTEL SCHEDULE

SPANS UP TO 4'-0"	(1) L3½x3½x5/16
4'-0" TO 6'-0"	(1) L4x3½x5/16
6'-0" TO 8'-0"	(1) L5x3½x5/16
8'-0" TO 10'-0"	(1) L6x3½x5/16

NOTES:
1. ONE ANGLE REQUIRED FOR EACH 4" OF WALL THICKNESS.MINIMUM BEARING 6".
2. LINTELS ARE DESIGNED TO CARRY BRICK OR LIGHTER WALL CONSTRUCTION ONLY. LINTELS ARE NOT DESIGNED TO CARRY ANY ROOF LOAD.
3. WHERE UNEQUAL ANGLES ARE USED, PLACE LONG LEG VERTICAL.

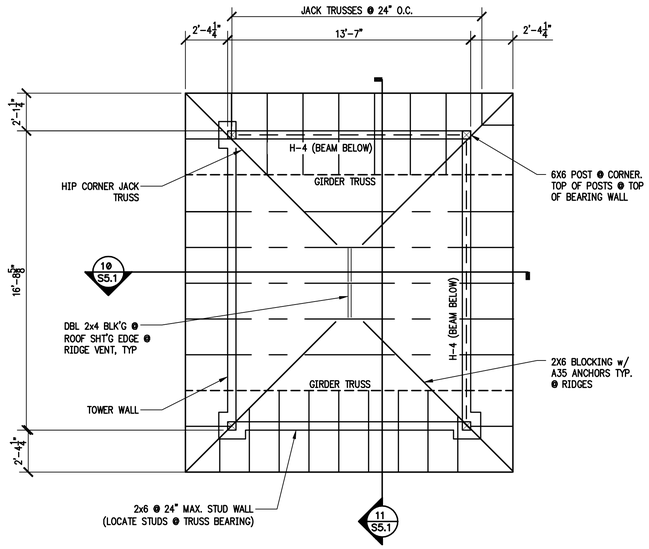

ENTRY ROOF FRAMING PLAN

SCALE: 1/4"=1'-0"

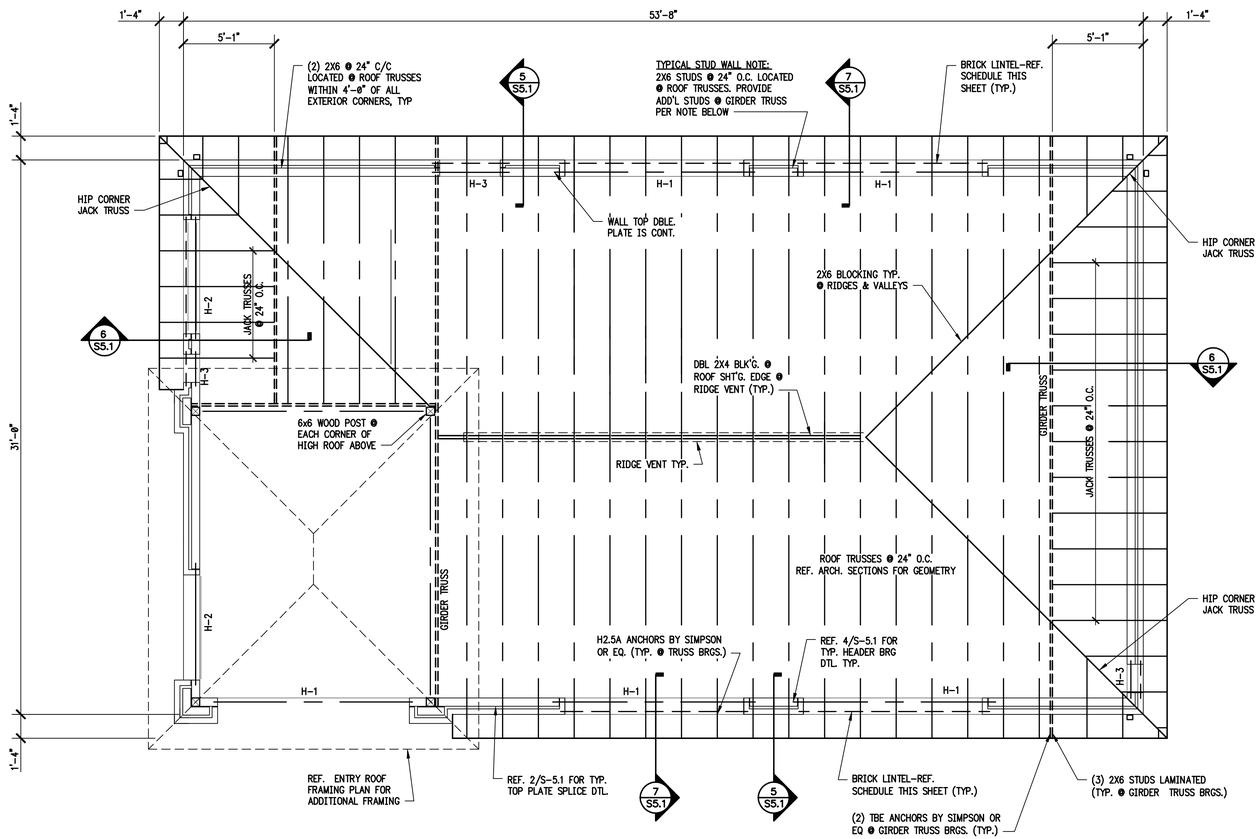

ROOF FRAMING PLAN

SCALE: 1/4"=1'-0"

1. DESIGN LIVE LOADS: ROOF SNOW LOAD BASED ON 10 PSF GROUND SNOW LOAD. SEE 1/S-1 FOR TRUSS LOADING.
2. TRUSS BEARING ELEVATION = 14'-0" AFF
3. VERIFY ALL WOOD TRUSS DIMENSIONS AND GEOMETRIES WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS PRIOR TO DESIGNING AND FABRICATING TRUSSES.
4. REFERENCES: GENERAL STRUCTURAL NOTES – S-1.
5. SYMBOL LEGEND:

H-# -INDICATES HEADER TYPE. SEE SCHEDULE ON SHEET S-5.

CESO
WWW.CESOINC.COM
8534 YANKEE ST., SUITE 2B, DAYTON, OH 45459
PHONE: (937) 435-8584 FAX: (937) 435-3307

No.	Revisions/Submissions	Date
	ISSUED FOR BID/PERMIT	12.18.17
	ISSUED FOR OWNER/LL REVIEW	12.04.17

VALVOLINE INSTANT OIL CHANGE
2007 W. ANDREW JOHNSON HIGHWAY
MORRISTOWN, TN. 37814

© 2017 CESO, INC

Project No.	754469.01
Scale	AS NOTED
Drawn	CESO
Checked	BWH
Date	12.18.17

Drawing Title

ROOF FRAMING PLAN

Drawing No. **S-5**

Z:\20173 Retail\317-002.BAS - Valvoline IOC Misc - 2017\317-002.018 - Morristown, TN\Deliverables\Our Dwgs\317-002.018_S-5 - ROOF FRAMING PLAN . 12/13/2017 8:20:01 AM . CRP