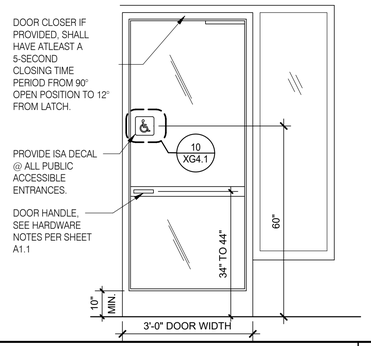

TYP. ENTRANCE / EXIT DOOR N.T.S. **17**

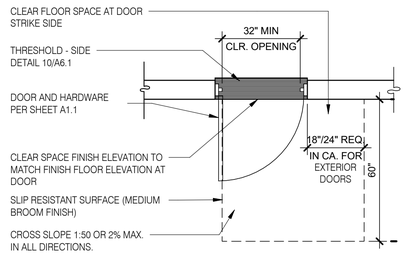

NOTE:
1. EXTERIOR DOOR PRESSURE CANNOT EXCEED 8.5 LBS (GC TO DOOR PRESSURE TO MINIMUM ALLOWABLE BY AHJ).
2. INTERIOR DOOR PRESSURE CANNOT EXCEED 5 LBS.
3. 60% OF PUBLIC ENTRANCES MUST BE ACCESSIBLE (100% IN CA)

EXTERIOR DOOR REQUIREMENTS 3/8" = 1'-0" **13**

TRUNCATED DOMES 3/8" = 1'-0" **18**

BOTTOM RAIL (EXTERIROR DOOR) 3" = 1'-0" **14**

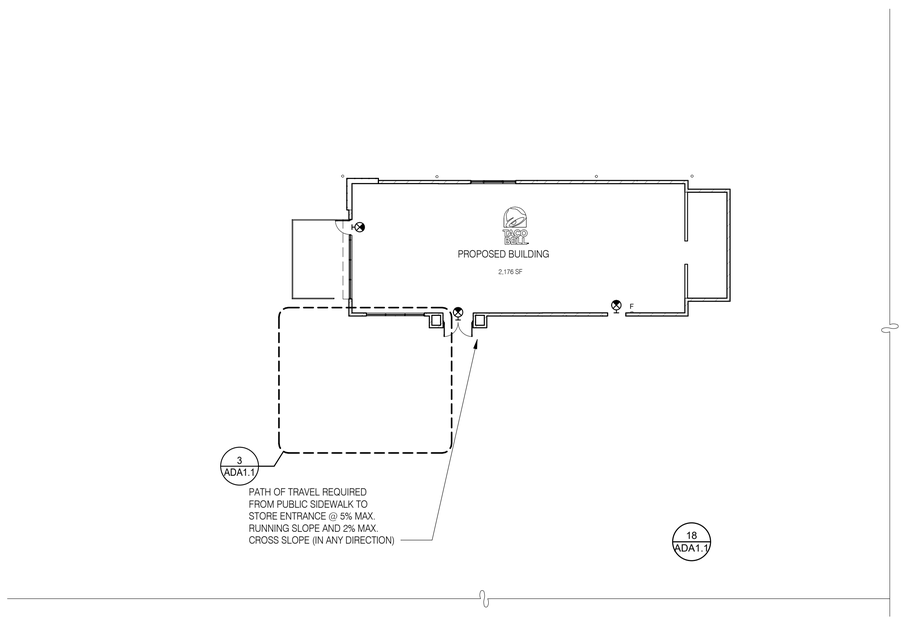

EXTERIOR PATH OF TRAVEL 1/16" = 1'-0" **2**

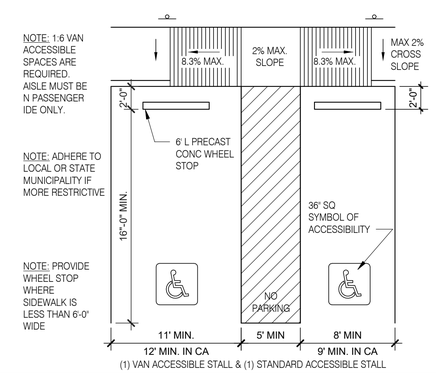

(1) VAN ACCESSIBLE STALL & (1) STANDARD ACCESSIBLE STALL

VAN ACCESSIBLE PARKING STALL N.T.S. **11**

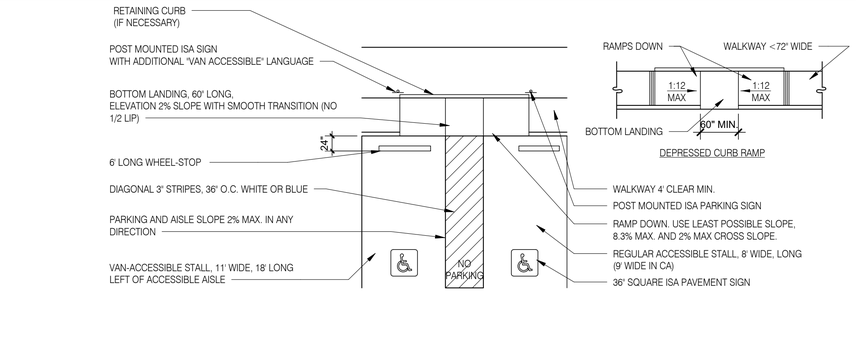

CURB RAMPS N.T.S. **3**

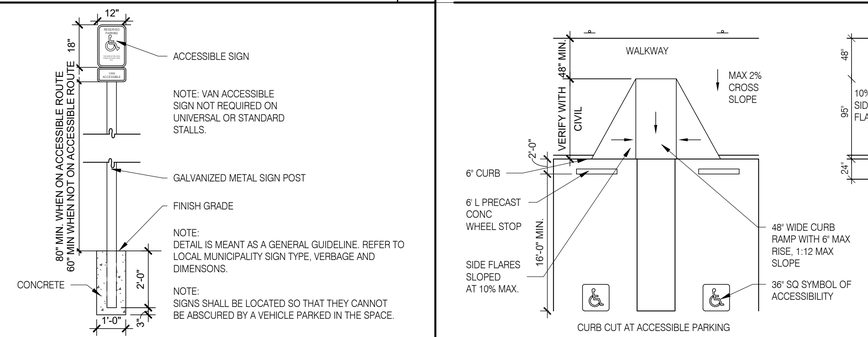

ACCESSIBLE PARKING SIGN N.T.S. **12**

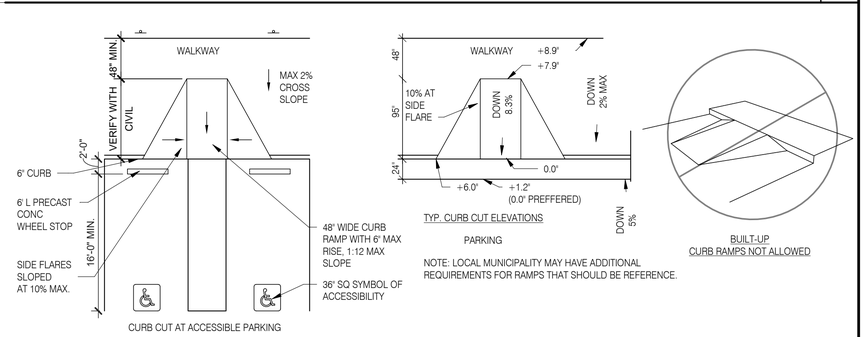

CURB RAMPS-1 N.T.S. **4**

NRD national restaurant designers
ARCHITECTS & ENGINEERS
7208 Ace Blvd. 2nd Floor Raleigh NC 27617
phone: 919.544.0087 fax: 919.544.9339
A Division of LMHT Associates

BRIAN L. JONES REGISTERED ARCHITECT SOUTH CAROLINA No. 9852

05.19.22

STATE OF SOUTH CAROLINA LMHT ASSOCIATES, P.A. Morrisville, NC No. C84006 REGISTERED ARCHITECTS

	DATE	REMARKS

CONTRACT DATE:	03/31/2022
BUILDING TYPE:	END. MED 40
PLAN VERSION:	SEPT. 2021
BRAND DESIGNER:	
SITE NUMBER:	315669
ENTITY NUMBER:	458169
PA/PM:	Approver
DRAWN BY.:	Author
JOB NO.:	22204

ENDEAVOR 2.0
SPEARS CREEK CHURCH RD
(BY LIBERTY RIDGE DRIVE)
SOUTH CAROLINA 29229

TACO BELL

ENDEAVOR 2.0
ACCESSIBILITY REQUIREMENTS

ADA1.1

PLOT DATE: 5/18/2022 2:23:55 PM

PROJECT #22204

C:\Users\woodDocuments\22204 Spears Creek_CWoodMR22V.rvt

CAUTION: IF THIS SHEET IS NOT 22"x34" IT IS A REDUCED PRINT